




SIDE VIEW FRONT VIEW RECOMMENDED FRONT CUT-OUT
 30-200 AMP SERIES J SWITCHES

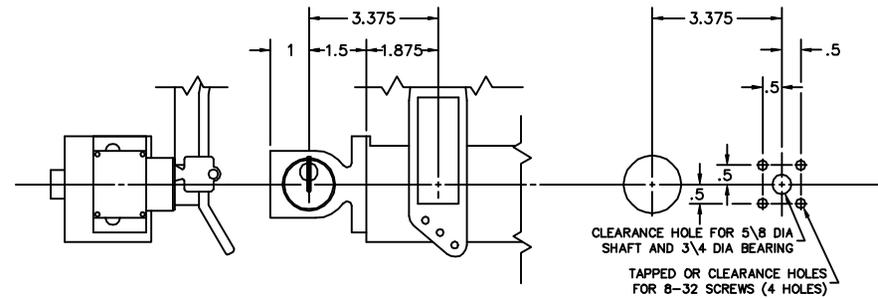

SIDE VIEW FRONT VIEW RECOMMENDED FRONT CUT-OUT
 400-600 AMP SERIES T SWITCHES

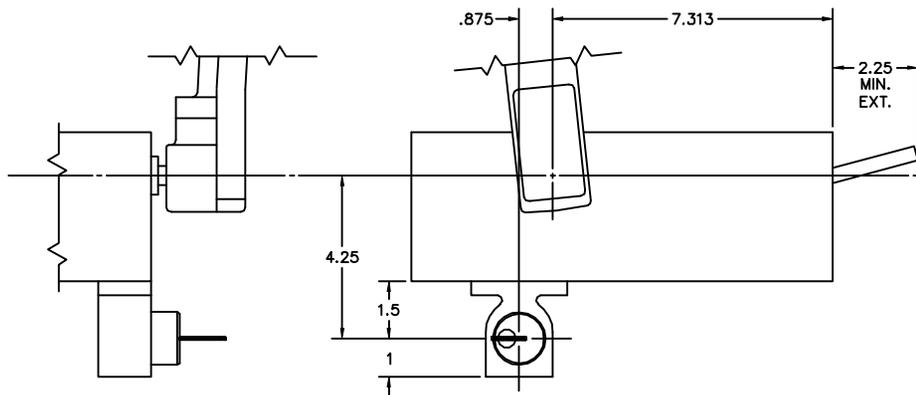

SIDE VIEW FRONT VIEW
 400-800 AMP SERIES B, R, J, & L SWITCHES AND 800-1200 AMP SERIES T

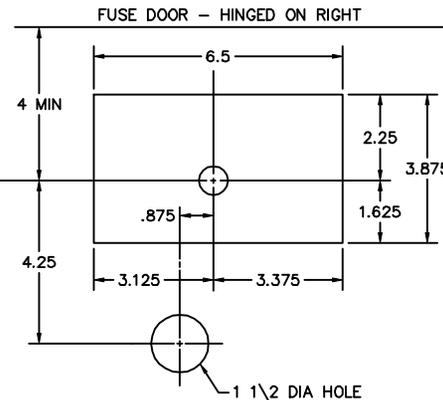


RECOMMENDED FRONT CUT-OUT

NOTES:


- THIS DRAWING IS NOT APPLICABLE FOR SWITCHES WITH SHUNT TRIP OPERATORS. REFER TO DRAWING 0-1075
- THE RECTANGULAR CUT-OUTS ARE REQUIRED WHEN USING OPTIONAL E.U.S.E.R.C. PADLOCK CLIPS.

KEY INTERLOCK SPECIFICATIONS:

- 3/8 BOLT PROJECTION WHEN WITHDRAWN
- KIRK TYPE B
- SUPERIOR TYPE B 6003

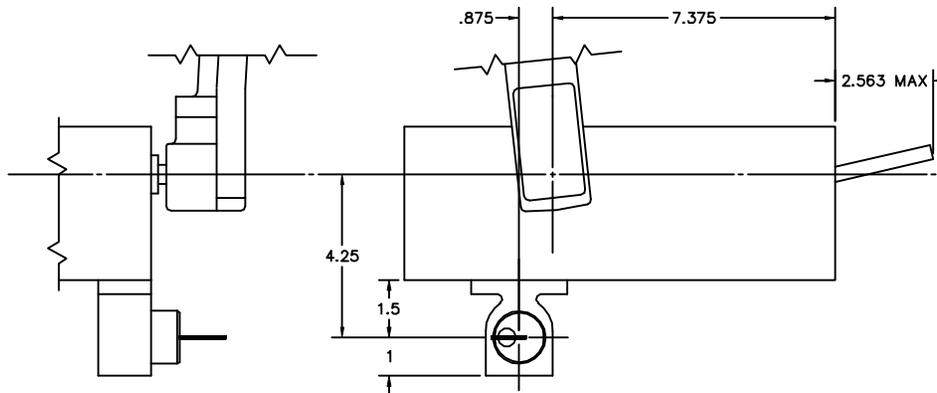

SIDE VIEW FRONT VIEW
 1200 AMP SERIES L SWITCHES

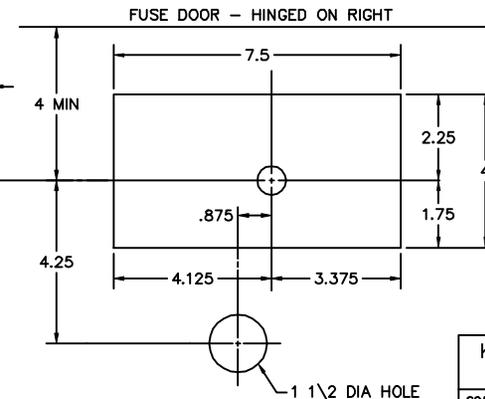

RECOMMENDED FRONT CUT-OUT

REV 13 REDRAWN ON CAD, NEW FRONT CUT-OUTS 7-11-97 RME
 REV 12 NEW LOCK LOCATION NOTE ADDED 7-1-91 JAE
 REV 11 SPRING FLUIDE DIMENSION ADDED 6-9-86 JAE
 REV 10 VM & SM ADDED 6-21-85 JAE
 REV 9 800-1200 AMP SERIES T ADDED 8-13-81 JAE
 REV 8 DWG REDRAWN, 50-200 AMP J, T, & R ADDED 5-29-80 JAE

KEY INTERLOCKS ON SERIES B, R, J, L, & T SWITCHES WITH MANUAL OPERATORS		
SCALE:	APPROVED BY:	DRAWN BY JAE
DATE: 5-29-80		REVISED 13
boltswitch, Inc. CRYSTAL LAKE, ILLINOIS 60014		DRAWING NUMBER 0-1023