



NOTES

- ITEMS MARKED WITH * ARE ONLY ON SWITCHES WITH INTEGRAL GROUND FAULT
- FOR WIRING DIAGRAMS SEE DRAWING NO. O-1522, OR O-1522A FOR SWITCHES WITH INTEGRAL GROUND FAULT.




VENTILATION


WHEN THE SWITCH IS TOTALLY ENCLOSED, VENTILATING LOUVRES MUST BE PROVIDED YIELDING A MINIMUM OPEN AREA OF "E" SQUARE INCHES NEAR THE TOP OF THE ENCLOSURE, AND "E" SQUARE INCHES NEAR THE BOTTOM OF THE ENCLOSURE.

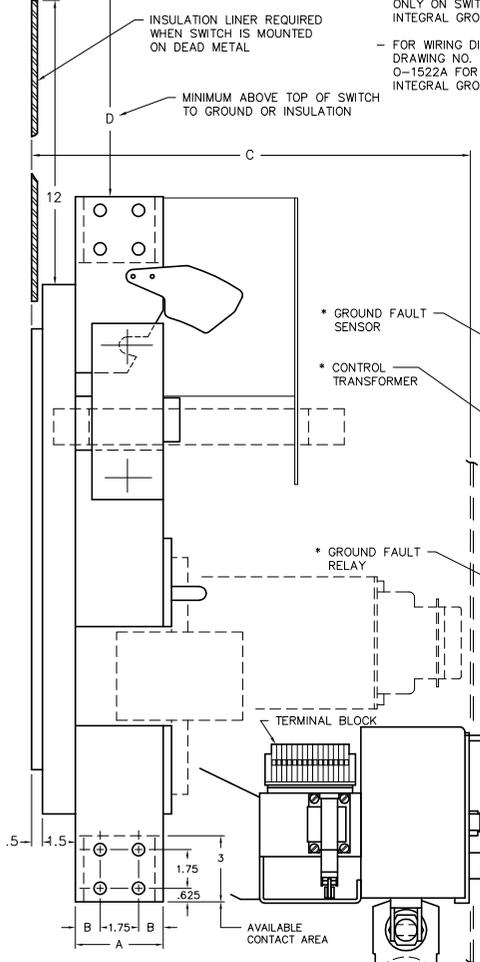

LEFT SIDE VIEW

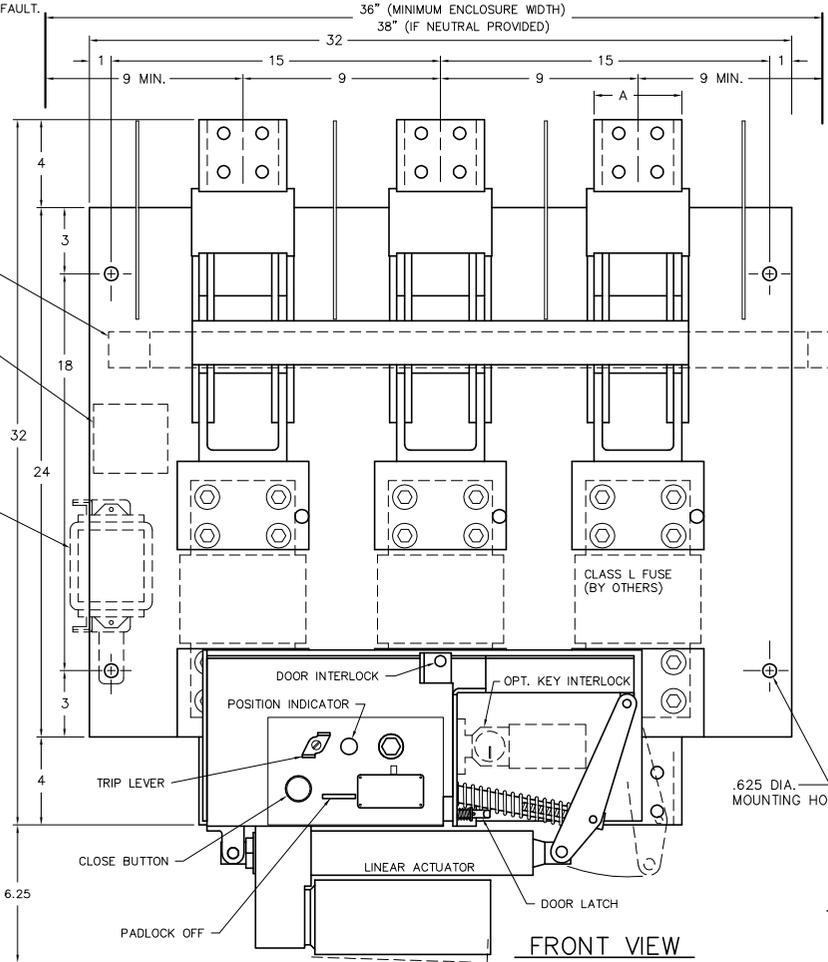


FRONT VIEW

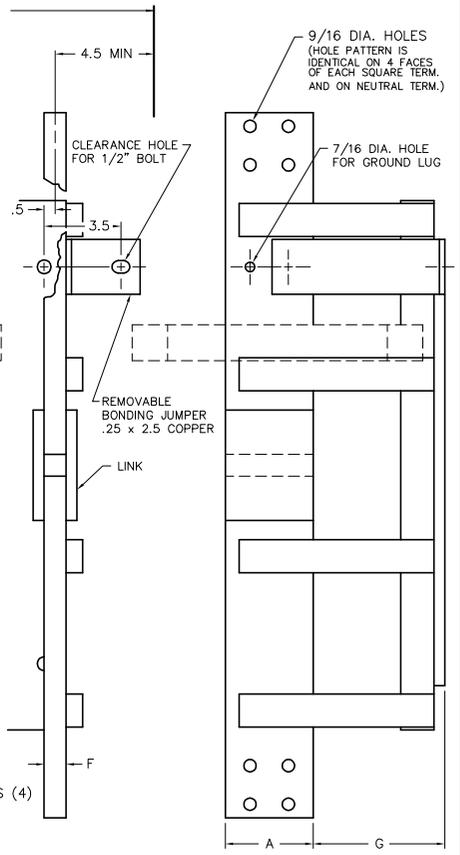

NEUTRAL

RIGHT SIDE VIEW
(ILLUSTRATES NEUTRAL ONLY)

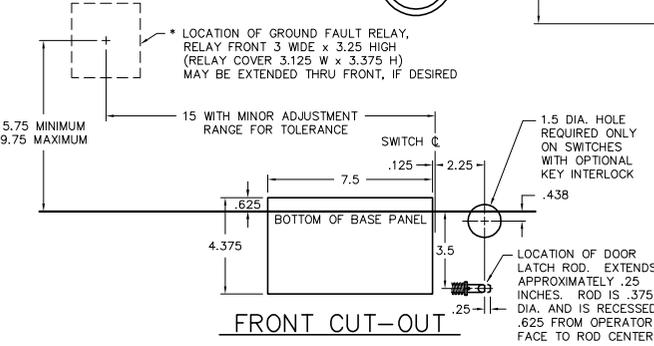

FRONT CUT-OUT

VOLTAGE	AMP	CATALOG NUMBER				NET WT. (3-P, 3-W)	A	B	C	D GND. INS.	E	F	G	
		2-P, 2-W	2-P, 3-W	3-P, 3-W	3-P, 4-W									
600	4000	SL2613-MST	SL3613-N-MST	SL3613-MST	SL4613-N-MST	345 LBS	4	1.125	20	16	8	80 SQ. IN.	1	6
	5000	SL2614-MST		SL3614-MST		385 LBS	5	1.625	22	16	8	120 SQ. IN.		
	6000	SL2615-MST		SL3615-MST		440 LBS	5	1.625	22	16	8	120 SQ. IN.		
4000	120/240		SL3613-G1-MST	SL3613-G2-MST										
	240													
	208Y/120				SL3613-G3-MST									
	240/120				SL3613-G4-MST									
	480			SL3613-G5-MST										
	480Y/277				SL3613-G6-MST									
	600			SL3613-G7-MST										
	600Y/347				SL3613-G8-MST									
	380Y/220				SL3613-G9-MST									

SWITCHES EQUIPPED WITH INTEGRAL GROUND FAULT PROTECTION EQUIPMENT

SERIES SL SWITCHES, 4000-6000A, 600VAC WITH MOTORIZED SHUNT TRIP OPERATOR

SCALE:	APPROVED BY:	DRAWN BY: WCE
DATE: 8-27-92		REVISED: 6

boltswitch, inc.
CRYSTAL LAKE, ILLINOIS 60014

DRAWING NUMBER
O-1118A