


FRONT VIEW

SIDE VIEW

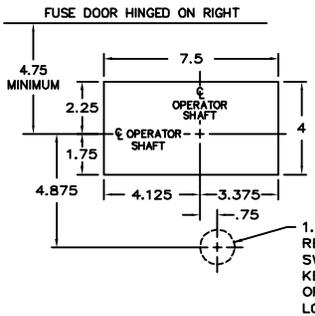

RECOMMENDED FRONT CUT-OUT

OPERATOR DETAILS

FOR OPERATOR DETAILS AND ALTERNATE FRONT CUT-OUTS, REFER TO THE FOLLOWING DRAWINGS:
 O-1023A MANUAL OPERATOR
 O-1090A SHUNT TRIP OPERATOR

KEY INTERLOCK

KEY INTERLOCK SPECIFICATIONS FOR SWITCHES EQUIPPED WITH KEY INTERLOCK PROVISIONS ARE:
 .375 BOLT PROJECTION WHEN WITHDRAWN
 - KIRK TYPE B
 - SUPERIOR TYPE B6003

VENTILATION

WHEN THE SWITCH IS TOTALLY ENCLOSED, VENTILATING LOUVRES MUST BE PROVIDED YIELDING A MINIMUM OPEN AREA OF "E" SQUARE INCHES NEAR THE TOP OF THE ENCLOSURE, AND "E" SQUARE INCHES NEAR THE BOTTOM OF THE ENCLOSURE.

AMP	CATALOG NUMBER	NET WEIGHT	A	B	C	D	E
						GND. INS.	
4000	SL4613		4" SQUARE	1.125	15.25	16	8 80 SQ. IN.
5000	SL4614		5" SQUARE	1.625	17.25	16	8 120 SQ. IN.
6000	SL4615		5" SQUARE	1.625	17.25	16	8 120 SQ. IN.

NOTE: FOR SWITCHES EQUIPPED WITH OPTIONAL SHUNT TRIP, ADD SUFFIX -ST TO CATALOG NUMBER

4000-6000 A. 4-POLE 600 V.A.C. FUSIBLE SWITCHES

SCALE:	APPROVED BY:	DRAWN BY JAE
DATE: 6-28-76		REVISED 2

boltswitch, inc.
CRYSTAL LAKE, ILLINOIS 60014

DRAWING NUMBER
O-1140