




BLOWN FUSE ALARM

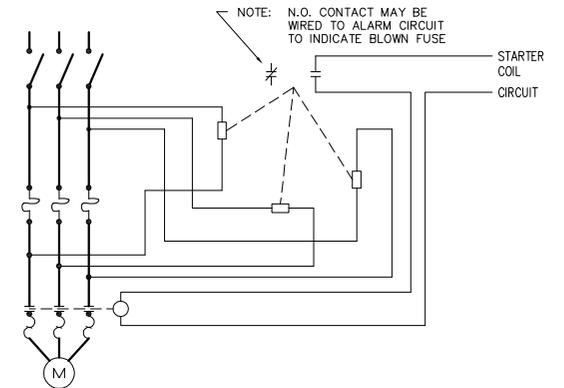

BLOWN FUSE DETECTOR WITH COMBINATION STARTER

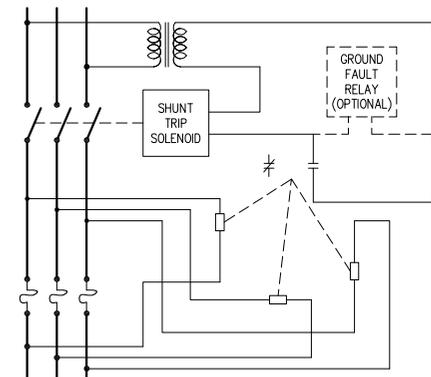

BLOWN FUSE DETECTOR WITH SHUNT TRIP OPERATOR

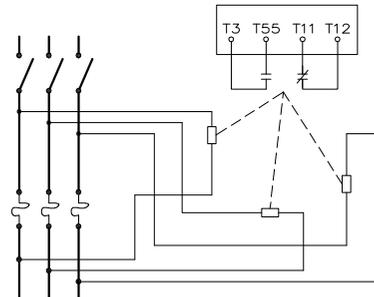

BLOWN FUSE DETECTOR WITH MOTORIZED SHUNT TRIP OPERATOR

NOTE:
ALL WIRING MUST BE
#12 AWG MINIMUM

PW-2 "PADDLE WHEEL" BLOWN FUSE DETECTOR		
SCALE:	APPROVED BY:	DRAWN BY JWE
DATE: 4-7-83		REVISED 1
boltswitch, inc. CRYSTAL LAKE, ILLINOIS 60014		DRAWING NUMBER O-1363