
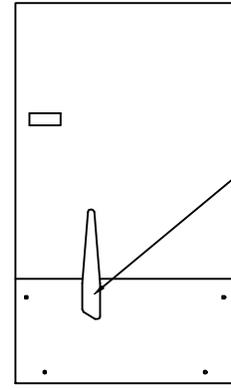


FOR OPTIONAL RELAY RACK MOUNTING,
REFER TO DWG. NO. 0-1500

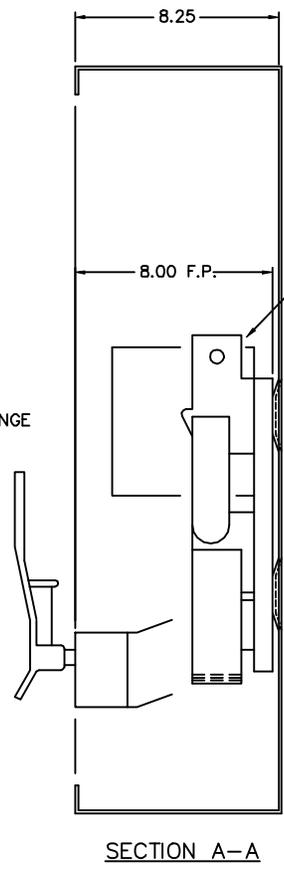

FRONT

CONSTRUCTION: NEMA 1

NOTE: UNIT IS DESIGNED FOR TOP ENTRY AND
EXIT OF CABLES. KNOCKOUTS MAY BE
PROVIDED IN TOP OF UNIT.

CATALOG NUMBER	AMPACITY
ET114	200
ET115	400
ET116	600

200, 400 & 600 AMP, 1-POLE, 125 VDC BATTERY DISCONNECT SWITCH		
SCALE:	APPROVED BY:	DRAWN BY JAE
DATE: 4-1-91		REVISED 5
boltswitch, inc. CRYSTAL LAKE, ILLINOIS 60014		DRAWING NUMBER 0-1498

REV 5 CAT. NOS. WERE 0-1498-A&B, 200A ADDED. 3-2-95 JAE
 REV 4 REF TO 0-1549 ADDED 8-19-94 JAE
 REV 3 1.75 WAS 2.00 (CHANGED TO MATCH AS MFRED)
 AND RELAY RACK MTG NOTATION ADDED 4-30-93 JAE
 REV 2 DWG REDRAWN 4-1-91 JAE