
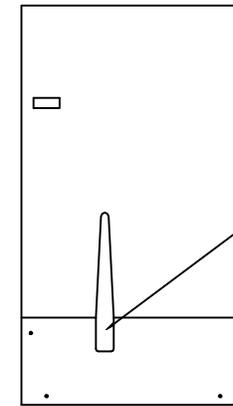


FOR OPTIONAL RELAY RACK MOUNTING,
REFER TO DWG. NO. 0-1500

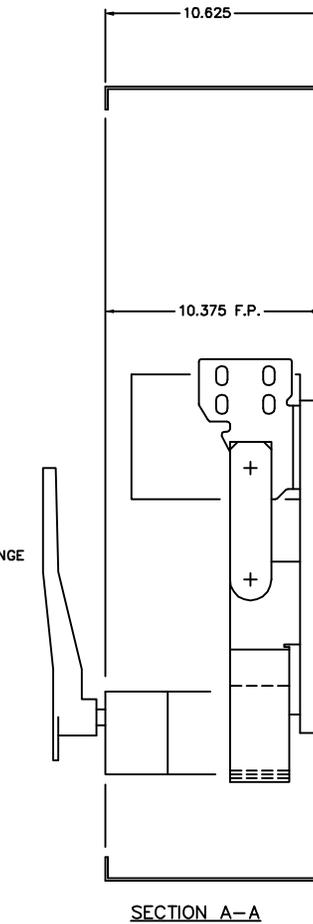

FRONT

CONSTRUCTION: NEMA 1

NOTE: UNIT IS DESIGNED FOR TOP ENTRY AND
EXIT OF CABLES. KNOCKOUTS MAY BE
PROVIDED IN TOP OF ENCLOSURE.

CATALOG NUMBER	AMPACITY
ET117	800
ET118	1200

800 & 1200 AMP, 1-POLE, 125 VDC
BATTERY DISCONNECT SWITCH

SCALE:	APPROVED BY:	DRAWN BY JAE
DATE: 4-2-91		REVISED 8

REV 8 NEW TERM DRILLING (ALT REMOVED) 11-27-00 JAE
 REV 7 CAT. NOS. WERE 0-1499-A&B 3-2-95 JAE
 REV 6 REF TO 0-1549 ADDED 8-19-94 JAE
 REV 5 RELAY RACK MTG NOTE ADDED 9-28-93 JAE
 REV 4 TERM DIMENSIONS ADDED 4-2-91 JAE
 REV 3 DWG REDRAWN 4-2-91 JAE

boltswitch, inc.
CRYSTAL LAKE, ILLINOIS 60014

DRAWING NUMBER
0-1499