
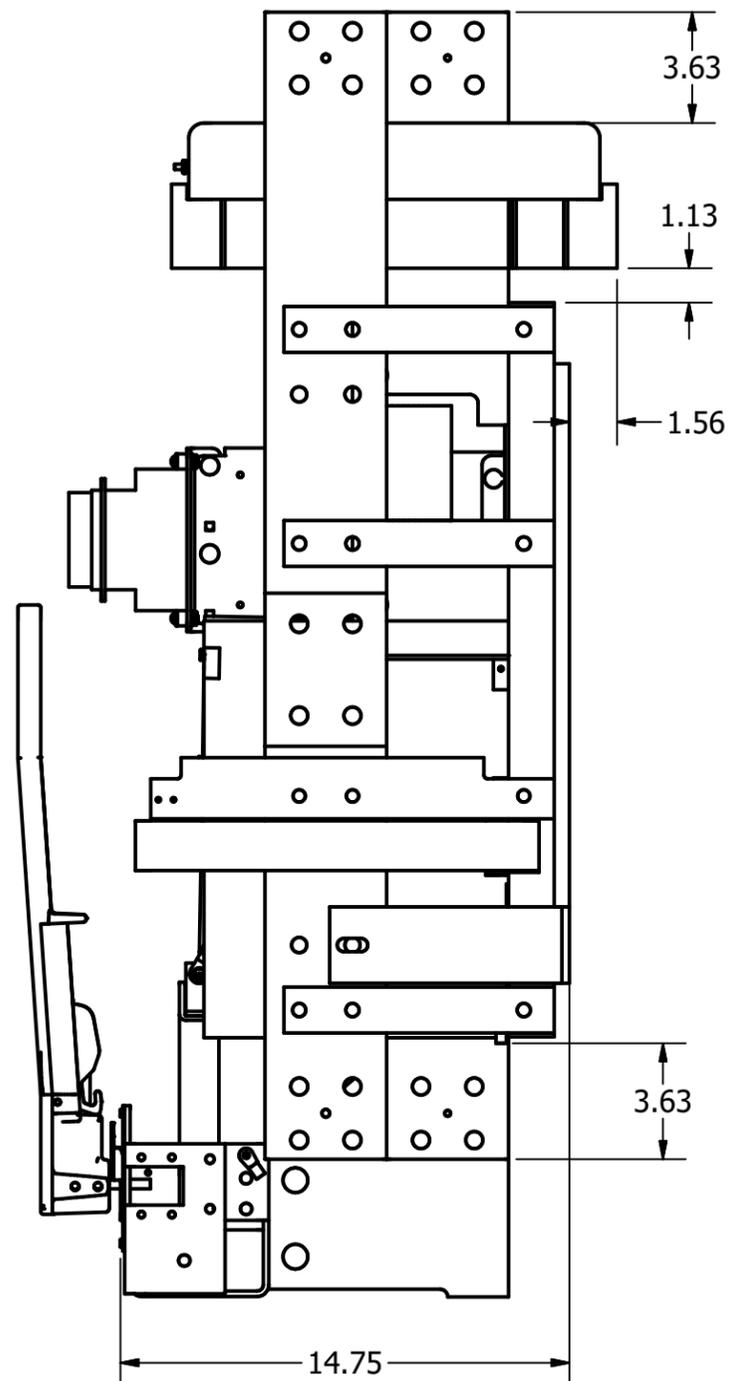


FOR NEUTRAL DETAILS SEE O-1116

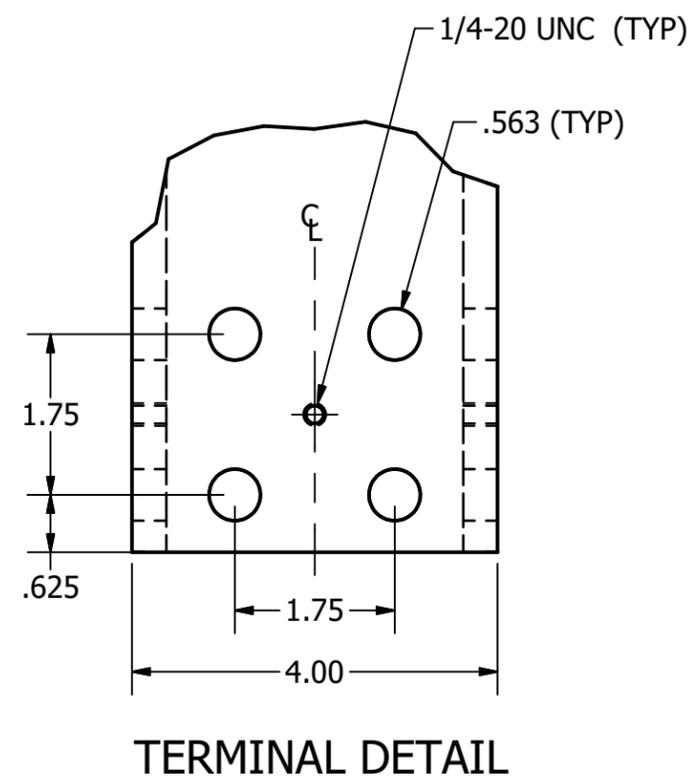

<p>4000 AMP. 480 V. SERIES SLB W/ARC FLASH AND GROUND FAULT SENSORS</p>	<p>O-1703 8/17/2021 MKingston</p>
<p><i><b>boltswitch, inc.</b></i> CRYSTAL LAKE, ILLINOIS 60014</p>	<p>REV. 1</p>